


M01 50kV T2: Avbrott

2019-03-09 07:06:09.800 - 0,24% - 1.179 sek

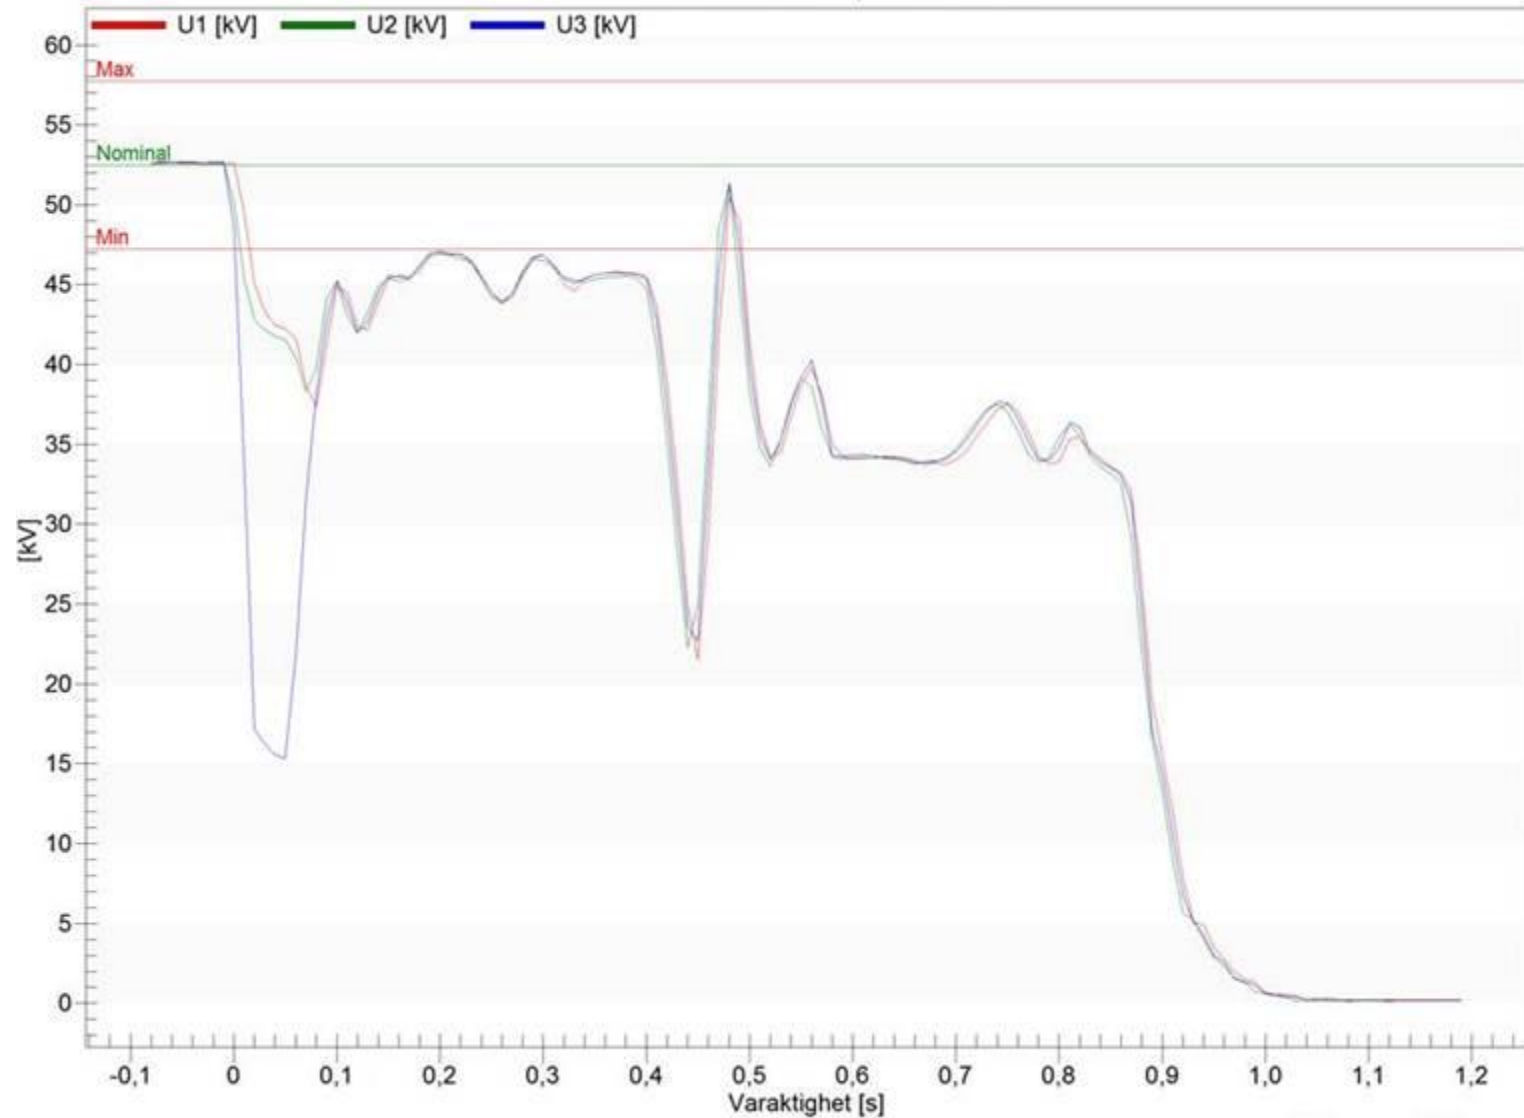

Unipower PQSecure